


» Kokemäki CHP powerplant

- Fuel drying by waste heat from the existing Kokemäki district heating plant
- Wood fuel
- Fuel capacity 7200 kW (6200 kW, when the boiler is not in operation)
- Power output 1836 kW_e
- District heat output 4300 kW (3100 kW, when the boiler is not in operation)
- Heat output to the fuel dryer 429 kW
- Start up with one JMS 316 engine(600 kW) in winter 2004/2005
- Start up of the two subsequent JMS 316 engines (à 600 kW) in winter 2005/2006

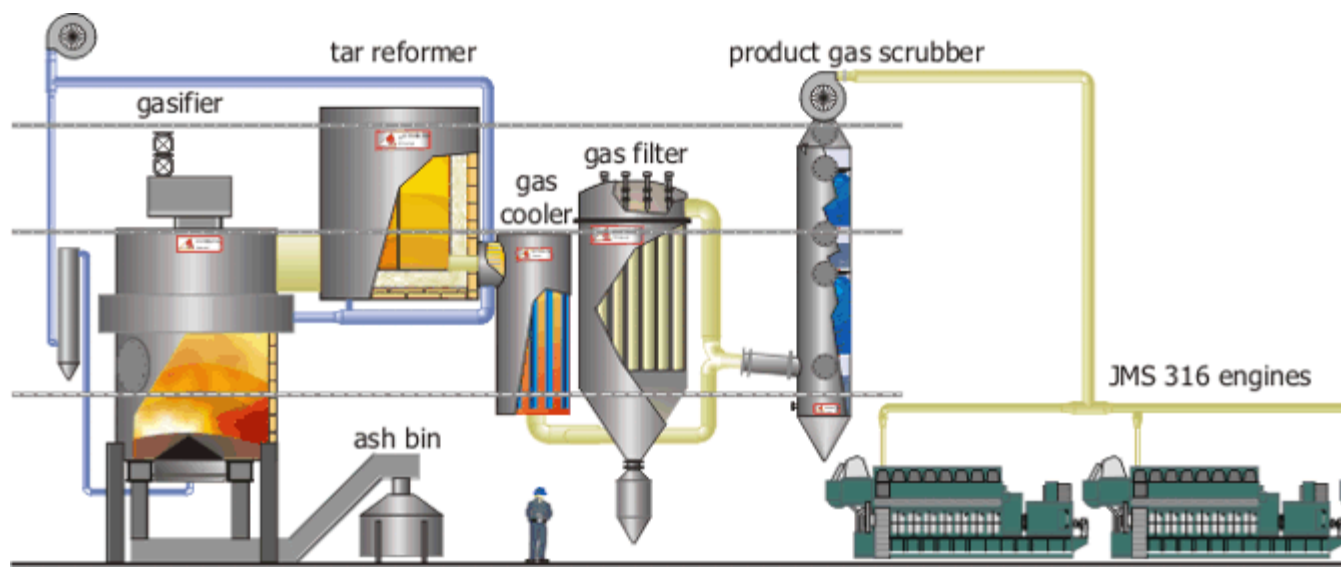

[Co]